

# MISSISSIPPI POWER COMPANY SELF-CONTAINED METER SOCKET SELECTION GUIDE




Date 10/13/95

Plate 89


MS0005

SUBJECT DETAIL  
**METER SOCKET SELECTION GUIDE**


DISTRIBUTION SPECIFICATIONS

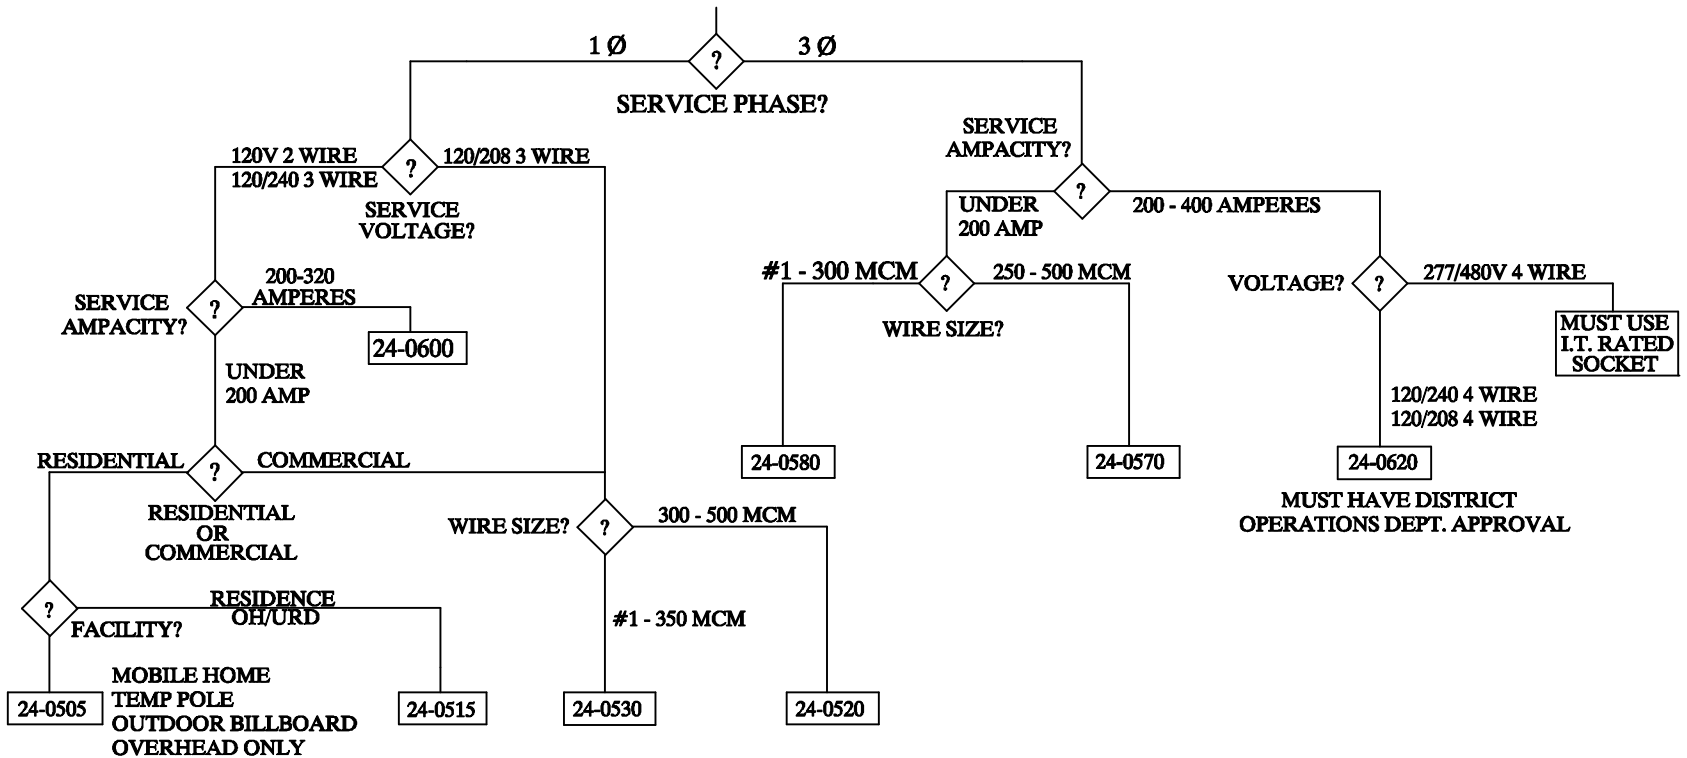

JULY 1992

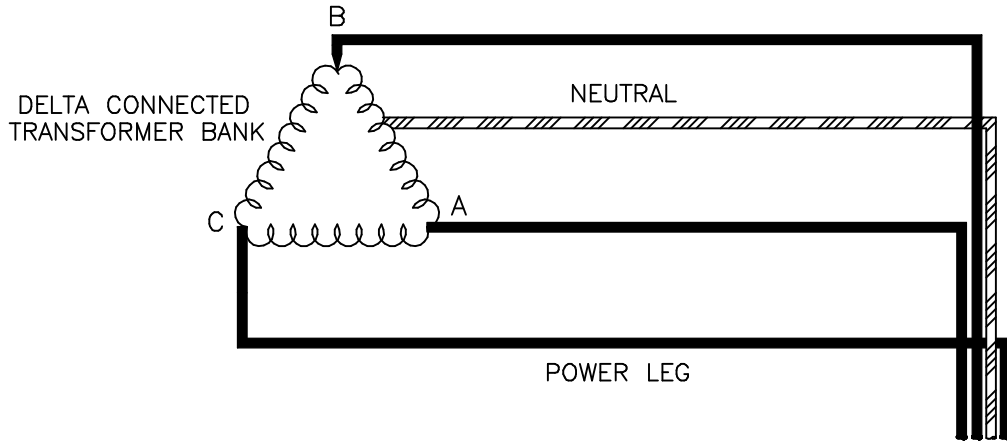

POWER LEG MUST BE "C" PHASE IN METER SOCKET FOR CORRECT METER REGISTRATION

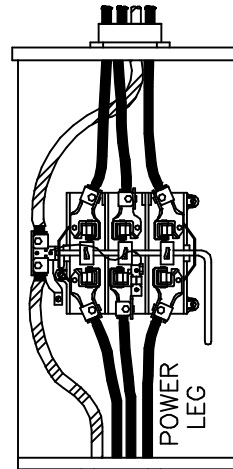

POWER LEG MUST BE IN FAR RIGHT POSITION

POWER LEG MUST BE "B" PHASE IN CUSTOMER'S SWITCHBOARD OR PANELBOARD TO COMPLY WITH SECTION 384-3(F) OF THE NATIONAL ELECTRICAL CODE.

