
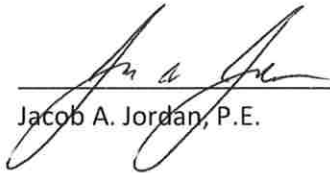


<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
<b>FACILITY NAME:</b> Plant Victor Daniel – Bottom Ash Pond Dam		
<b>OWNER/OPERATOR OF FACILITY:</b> Mississippi Power Company		
<b>INSPECTION DATE:</b> November 30, 2021		
<b>INSPECTING ENGINEER:</b> Jacob A. Jordan, P.E. (Mississippi P.E. License #27315) Southern Company Services – Principal Engineer, Fossil Dam Safety		
<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>NO</b>	
<b>(IF YES, DESCRIBE):</b>		
<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>N/A (no instrumentation)</b>	
<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>N/A (no instrumentation)</b>	
<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION</b>		
MIN. DEPTH: 0 ft*	MAX. DEPTH: 0 ft*	PRESENT DEPTH: 0 ft*
MIN. ELEVATION: N/A	MAX. ELEVATION: N/A	PRESENT. ELEVATION: N/A
<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.</b>		
MIN. DEPTH: 0 ft*	MAX. DEPTH: 0 ft*	PRESENT DEPTH: 0 ft*
MIN. ELEVATION: N/A	MAX. ELEVATION: N/A	PRESENT ELEVATION: N/A
<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION.</b>	<b>N/A*</b>	
<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION</b>	<b>WATER:</b> 0 yd <sup>3</sup> *	<b>CCR:</b> 0 yd <sup>3</sup> *
<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
<b>(IF YES, DESCRIBE):</b>		
<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>YES</b>	
<b>(IF YES, DESCRIBE):</b> The impoundment has been dewatered and all CCR removed. Backfilling of the unit underway at the time of inspection for repurposing the facility as a treatment pond		

\*All water and CCR removed from the impoundment at the time of the inspection backfill placement underway.

Based on the results of my inspection and review of the data provided, it is my professional opinion that the report has been completed in accordance with 40 CFR 257.83(b).

  
\_\_\_\_\_  
Jacob A. Jordan, P.E.

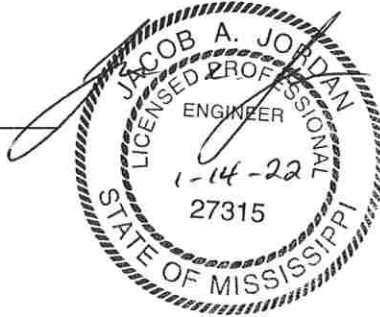

1/14/2022  
Date